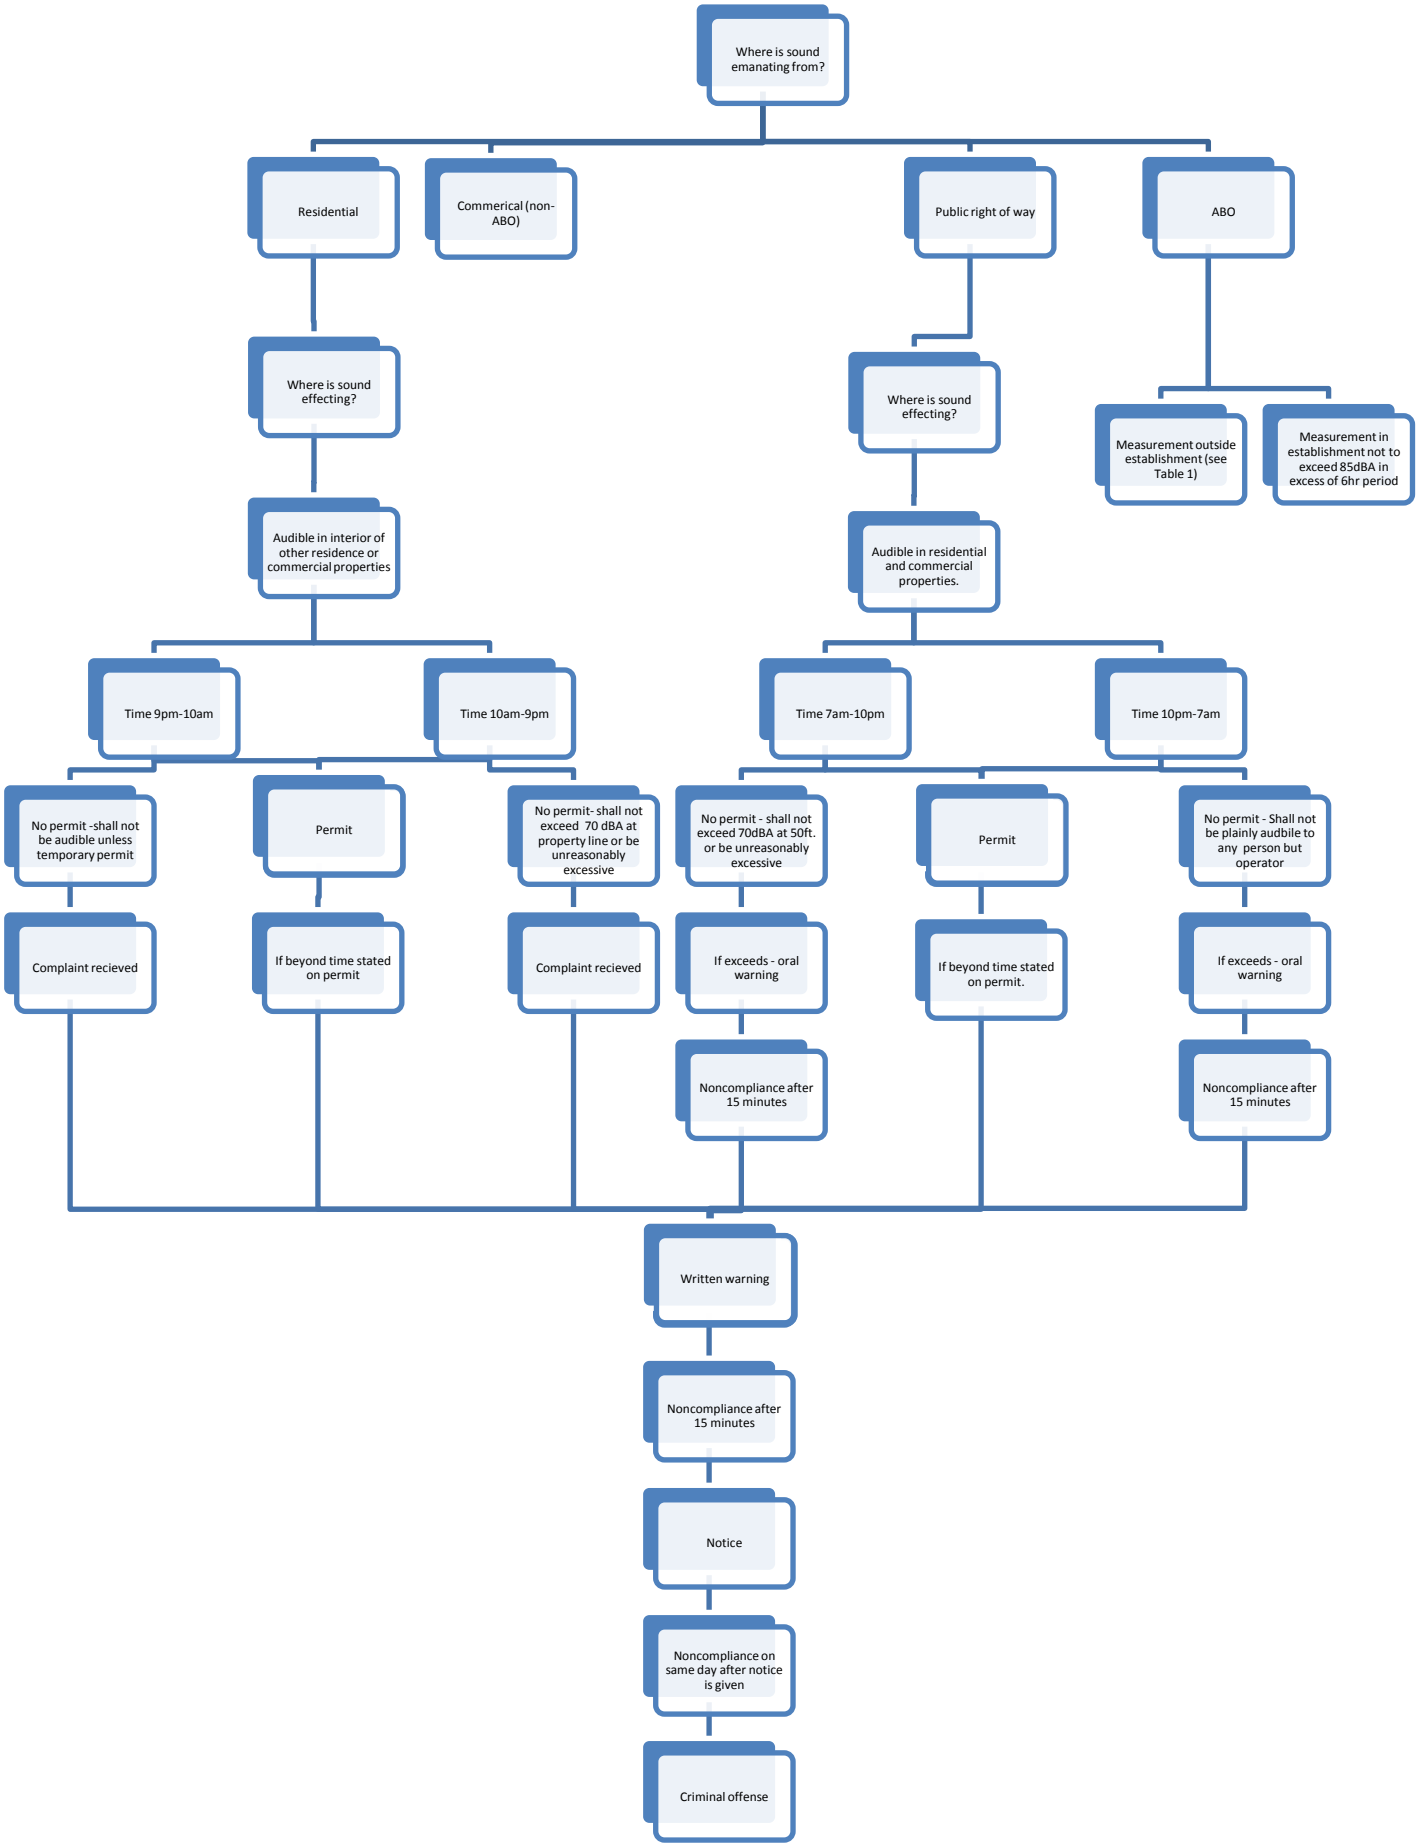
Where is sound emanating from?
Residential
Commerical (non-ABO)
Public right of way
ABO
Where is sound effecting?
Where is sound effecting?
Measurement outside establishment (see Table 1)
Measurement in establishment not to exceed 85dBA in excess of 6hr period
Audible in interior of other residence or commercial properties
Audible in residential and commercial properties.
Time 9pm-10am
Time 10am-9pm
Time 7am-10pm
Time 10pm-7am
No permit -shall not be audible unless temporary permit
Permit
No permit- shall not exceed 70 dBA at property line or be unreasonably excessive
No permit - shall not exceed 70dBA at 50ft. or be unreasonably excessive
Permit
No permit - Shall not be plainly audbile to any person but operator
Complaint recieved
If beyond time stated on permit
Complaint recieved
If exceeds - oral warning
If beyond time stated on permit.
If exceeds - oral warning
Noncompliance after 15 minutes
Noncompliance after 15 minutes
Written warning
Noncompliance after 15 minutes
Notice
Noncompliance on same day after notice is given
Criminal offense